

CASA R5 Genius

Technical catalogue



QUICK FACTS

- Automatic rotor speed control for demand controlled humidity function as standard.
- Automatic summer function and passive cooling
- Anti-frost protection ensures continuous ventilation
- External coils for heating and cooling as an option
- Can be connected to the automated building management system (I/O/Modbus)
- Control system CASA Genius
- Can keep pressure balanced as a makeup air unit integrating with direct exhaust cooker hoods

UNIT TECHNICAL CONTENT

Air flow range	ERV: 127-248 cfm 60-117 l/s
Dimensions, w x l x h	23,5 x 23,6 x 23,5 inch, 165 lbs (598 x 600 x 597 mm, 75 kg)
Duct outlets	4 x 6" (152 mm)
Humidity recovery	83 %
Sound level	42 dB
Heat recovery rate	82 %
Specific electric power	0,37 Wh/m ³
Connection power	887 BTU/hr (260 W)
Power connection	220-240 V, 50-60 Hz, MOP 10 A
Fans	240 W, EC
Filters	MERV13 filters for supply air and for extract air
Colour	Exterior White, RAL 9016 (corresponds to NCS S1002-G50Y)

Content

Technical description 3

CASA Genius control 6

Design data 8

 Air flows 10

 Functional diagram 12

 External connections 14

 Electrical wiring diagram 15

Installation..... 16

Dimensions and weight..... 17

Product codes 18

Performance Summary Sheet 19

Technical description

Swegon CASA R5 Genius

Compact and high performance Air handling unit with sensible/enthalpy rotary heat exchanger providing ventilation fresh air to smaller homes (up to 254 cfm, 2583 ft³). The market's most intelligent demand-controlled humidity function is standard. Developed, manufactured and tested for North American climate.

Indoor environmental quality

Ventilation control

The unit is controlled steplessly with automation functions to guarantee the best indoor environmental quality. The user can select five operating modes home, away, boost, travelling and home+ by using control panel or Swegon CASA app. Operation modes can be set by defining a weekly programs on CASA controller or CASA app.

Temperature control

The supply air temperature is controlled with heat exchanger. Supply air temperature can be heated or cooled further using optional electric/hydronic heating coil or hydronic cooling coil.

The unit has automatic summer time detection. The function sets lower supply air temperature setpoint and boost ventilation in order to bring more fresh outdoor air to the apartment during summer nights.



Available variants

Standard units are available in following variants:

- ERV **R** (exhaust air right)
- ERV **L** (exhaust air left)

Components

Fans

CASA R5 comes with energy efficient EC fans on supply and extract air stream.

Filter

The ventilation unit is equipped with MERV13 filters for supply air and for extract air. The need of filter replacement is indicated on the control panel.

Heat exchanger

The ventilation unit is equipped with a **speed controlled rotary heat exchanger**. Heat exchanger is controlled either to maintain constant supply air temperature or to achieve maximum energy efficiency (winter mode).

External connections

All connections can be made without opening the electrical box. Plug-in modules are available for external connections. Wide variety of IO functions are available.

The ventilation unit is equipped with In-build Modbus. Modbus cabling can be made easily with external cable (SEC) or module (SEM). Unit can be fully controlled with Modbus and all external IO's can be configured to Modbus usage.

Protective functions

The heat exchanger freeze protection

The defrosting function guarantees continuous ventilation and maintains units performance even during extreme conditions. If reheat can't maintain sufficient supply air temperature, the air flows are reduced.

The fan overheating protection

The fan overheat protection stops the fan if the temperature rises too high and is reseted automatically. If protection stops the fans an alarm is generated.

Rotor guard

Rotor guard detects that the rotor is working. Malfunction generates an alarm.

Cold supply air

The ventilation unit has built-in condensation protection. If the supply air is too cold, the ventilation unit stops and an alarm is generated.

High temperature

If supply air or units internal temperature is detected dangerously high the unit is stopped and an alarm is generated.

Temperature sensors


If a sensor fault is detected, an alarm is generated. If the faulted sensor is critical the ventilation unit is stopped. The ventilation unit returns to normal mode once the fault has been corrected.

The delivery includes

- Ventilation unit
- Anti-vibration mountings (2 pcs.)
- Wall mounting bracket
- Quick Guide
- Installation and commissioning instruction

Standard connections

- Power cord with earthed plug (6,6 ft | 2 m)
- Modular cable with RJ9 connector (4,9 ft | 1.5 m)
- Freely configurable I/O contacts for connection of accessories (2 pcs.)

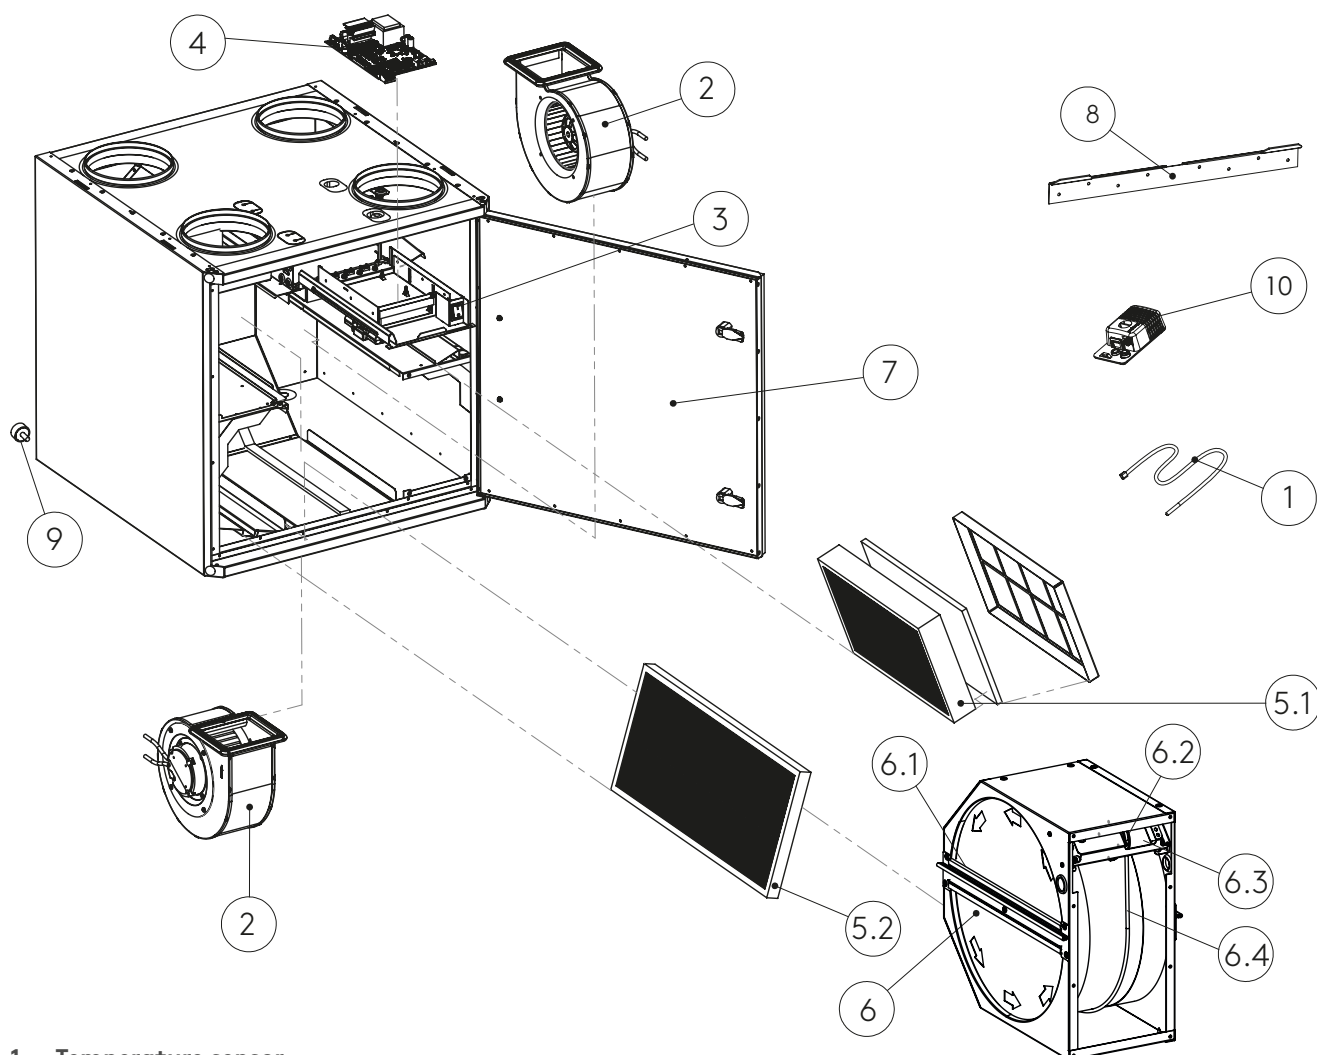

1. Temperature sensor
2. Fan (left + right)
3. Operating switch
4. Genius control board
5. MERV13 filters for supply air and for extract air
6. Rotor package
 - 6.1 Brush seals
 - 6.2 Drive wheel
 - 6.3 Rotor motor
 - 6.4 Drive belt
7. Door
8. Wall mounting bracket
9. Anti-vibration mountings (2 pcs.)
10. Sensor package

Swegon CASA Genius

Intelligent control of the ventilation

Using the Swegon CASA Genius control system, residents can monitor the quality of the indoor air (RH, CO₂, VOC, °F, °C), control the ventilation according to need or allow the intelligent control to regulate the ventilation automatically.

Swegon CASA control panel



Wall-mounted touch screen for external or flush mounting. From the touch screen, it is possible to monitor ventilation, change the ventilation's operating mode, change the equipment's settings and commission the ventilation unit. The screen can be connected to the home's WLAN network, enabling the ventilation to be controlled remotely from a mobile app.

The Swegon CASA app



Using this app, the home owner can use all the functions in the control panel remotely from their own smartphone. With the aid of the app, the user has access to more information about their home's air quality as well as valuable instructions and advice about the ventilation (needs Swegon Genius control panel).

The CASA Service app



App for installation engineers/service engineers, which provides assistance when commissioning the ventilation unit. The app works locally together with the ventilation unit and does not require connection to a network. For example, the app defines the I/O connections, presets the percentage values for the fan speeds that correspond to specified air volumes, as well as automatically setting air volumes for home and boost mode. Finished settings can be saved in the app and copied to the next home (needs Swegon Genius control panel).

Home automation



Can be connected to the home automation for centralised monitoring and control, either directly via configurable I/O or with the aid of a separate Modbus connection module (SEM).



Flat touch screen

Mobile app



Basic modes

You can switch as required to an appropriate operating mode or let the pre-programmed weekly clock switch operating mode according to the diurnal rhythm you want.



Home

Normal air flow. Sufficient amount of fresh indoor air to ensure the wellbeing of the residents and the structural building elements when there are people in the home.



Home+

Higher air flow. Can be used when more ventilation is required. The home owner can change the efficiency of the operating mode from the settings.



Boost

High air flow. Used if the ventilation requirement increases, for example, when cooking, taking a bath or drying laundry, or when an unusually large number of people are in the home.



Away

Low air flow. Reduces the energy consumption when nobody is present in the home.



Travelling

Very low air flow and lower supply air temperature. Used when nobody is present in the home.

Automatic functions

The intelligent ventilation monitors the quality of the indoor air and adjusts the ventilation automatically.



RH Humidity 35%

Automatic RH system included as standard

The humidity automation analyses the indoor air humidity continuously. The intelligent control utilizes heat exchanger (sorption rotor) high humidity recovery and rotor speed control to manage indoor humidity level. In addition the control boosts the ventilation steplessly by demand.



CO₂ Carbon dioxide 520 PPM

Automatic CO₂ system as optional equipment


Automatically lowers the ventilation and saves energy when nobody is in the home. When the residents are at home, the ventilation is automatically boosted to bring exactly the right amount of fresh air into the home.




VOC Air quality 950 PPM

Automatic VOC system as optional equipment

The automatic air quality system boosts the ventilation if pollution, odours or vapours (evaporating organic compounds) are detected in the indoor air.

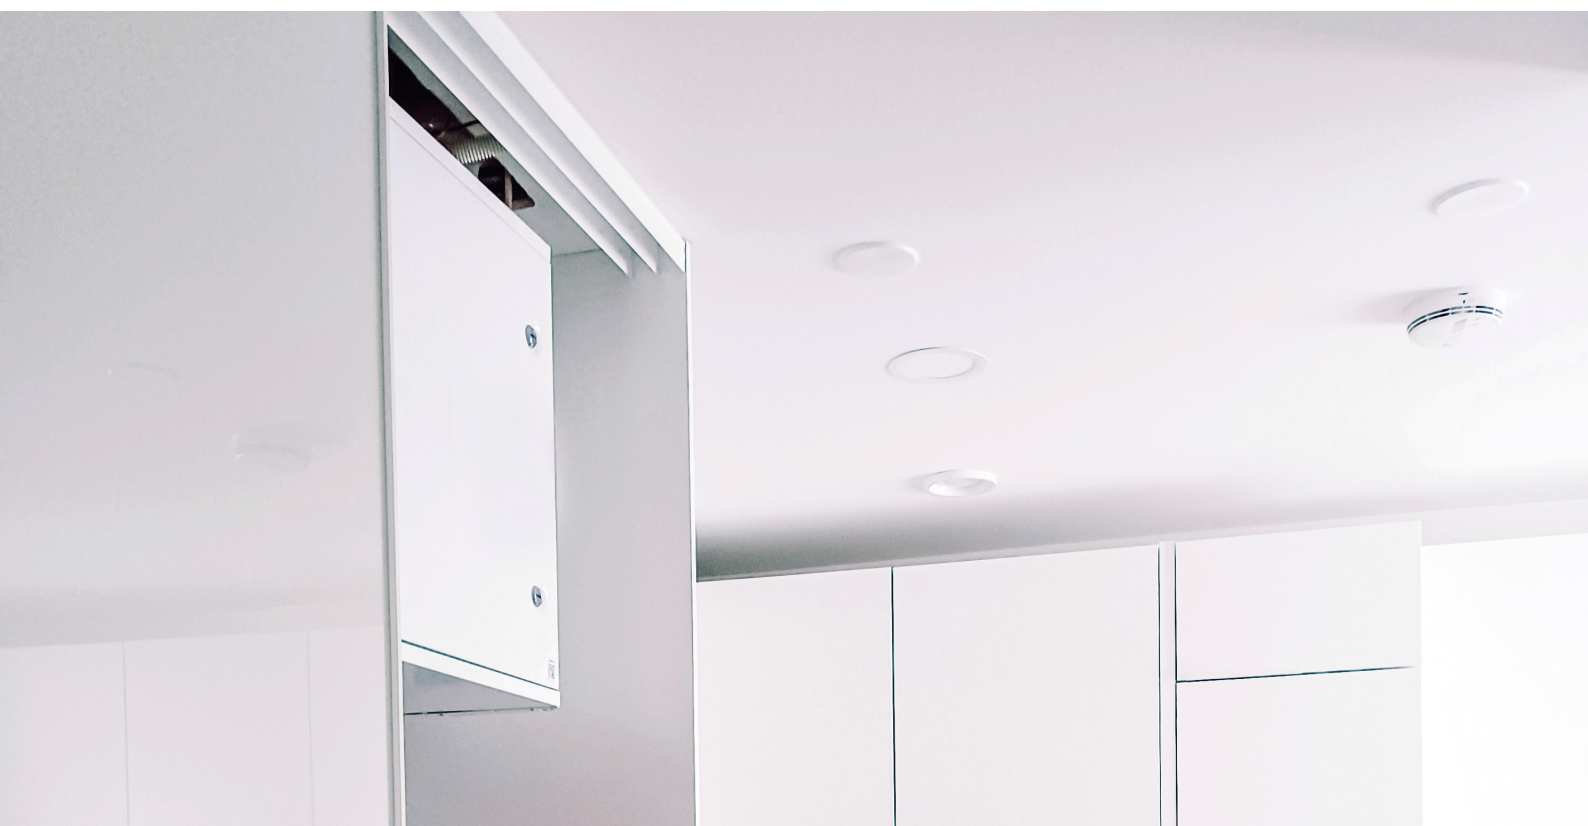

Design data

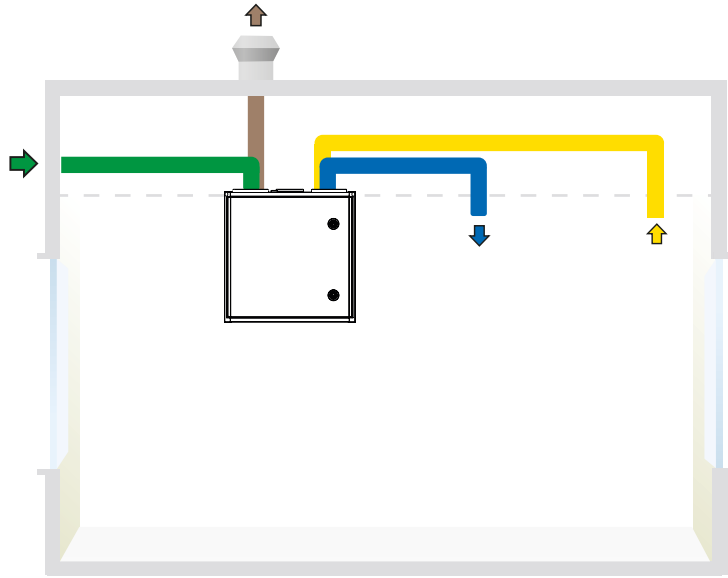

Outdoor air



Supply air



Extract air



Exhaust air


Note! Always check the unit design (L/R) and correct duct sequence in the installation instructions.



ProCASA®

Energy calculation, functional diagram and acoustic data on ProCASA.

procasa.swegon.com

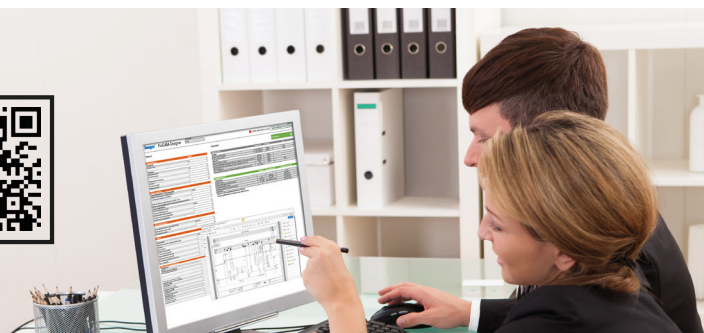

Energy calculator

Select area
CAN - Ottawa

37.4°F - 85.4°F
Source: ASHRAE Fundamentals 2001

ETL LISTED
Intertek
5025428

cool, temperate climate
CERTIFIED COMPONENT
Passive House Institute

☐ Exhaust

Select and print pages
☒ Energy calculation and dimensions

Project
Customer
Designed by
Location

Default values
Imperial
cfm

Air flow
Supply air: 127 cfm
Extract air: 127 cfm

Duct pressure
0.32 in. w.g. 0.32 in. w.g.

Cooker hood airflow: 0 cfm

usage time per day: 0 h/d

Indoor temperature 70°F
Minimum supply air temperature (+50°F...+70°F)
+50 +51 +52 +53 +54 +55 +56 +57 +58 +59 +60 +61 +62 +63 +64 +65 +66 +67 +68 +69 +70

Max airflow rate: 520 cfm
Sound power level: 44 dB(A)

Fan power and energy use EN13141-7

Supply air	23 W
Extract air	23 W
SFP	0.34 W/cfm
SFP	0.34 W/cfm
Annual energy use of fans	1.375 kWh



Energy used to heat the air EN13141-7

Reheating 63 °F	1,380 kWh	42W peak load
Energy used without heat recovery	28,730 kWh	
Annual energy efficiency for AHU (63 °F)	95 %	
Temperature efficiency of heat exchanger	85 %	
Temperature efficiency of air handling unit	80 %	

Acoustic data

Octave band (Hz)	63	125	250	500	1k	2k	4k	8k	L _{WA}
	L _w	L _w	L _w	L _w	L _w	L _w	L _w	L _w	L _{WA}
supply air duct	70	71	57	52	46	41	24	16	57
extract air duct	64	68	60	42	36	27	18	14	55
outdoor air duct	65	69	61	44	40	33	23	15	56
exhaust air duct	69	71	61	55	49	47	32	23	59
surroundings	49	51	43	34	27	24	24	26	40

surroundings at -4dB sound attenuation
L_{WA} dB(A) 36

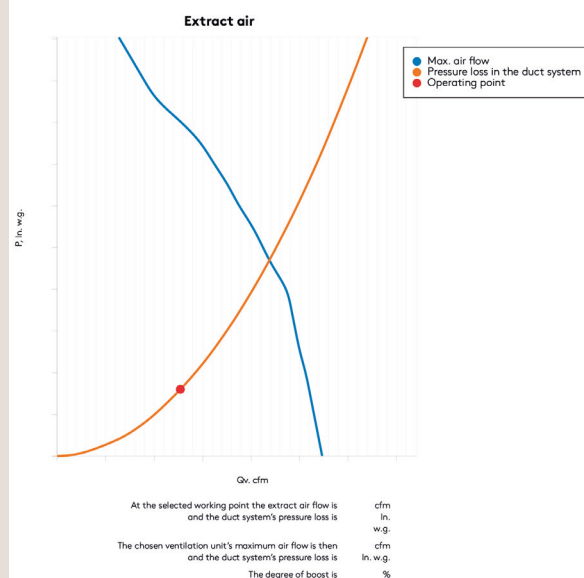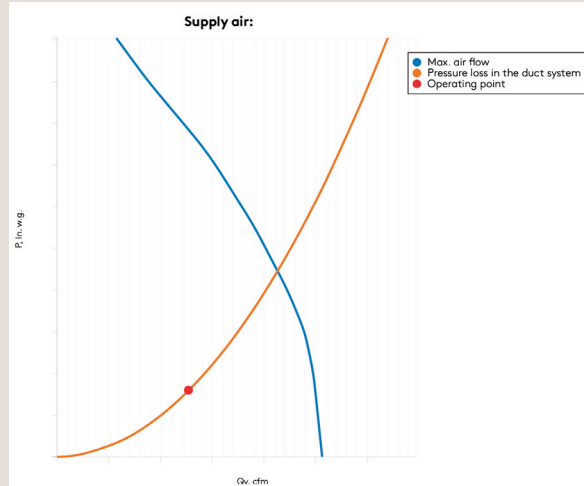

3D models and CAD dimension sketches for all Swegon CASA products are available from MagiCloud. You can download DXF files directly from MagiCloud or use a MagiCAD plugin to transfer dimension sketches to the Revit and AutoCAD software packages.


www.magicloud.com

Air flows

Air flows EN 13141-4

R5

— Supply airflow
 - - - Extract airflow

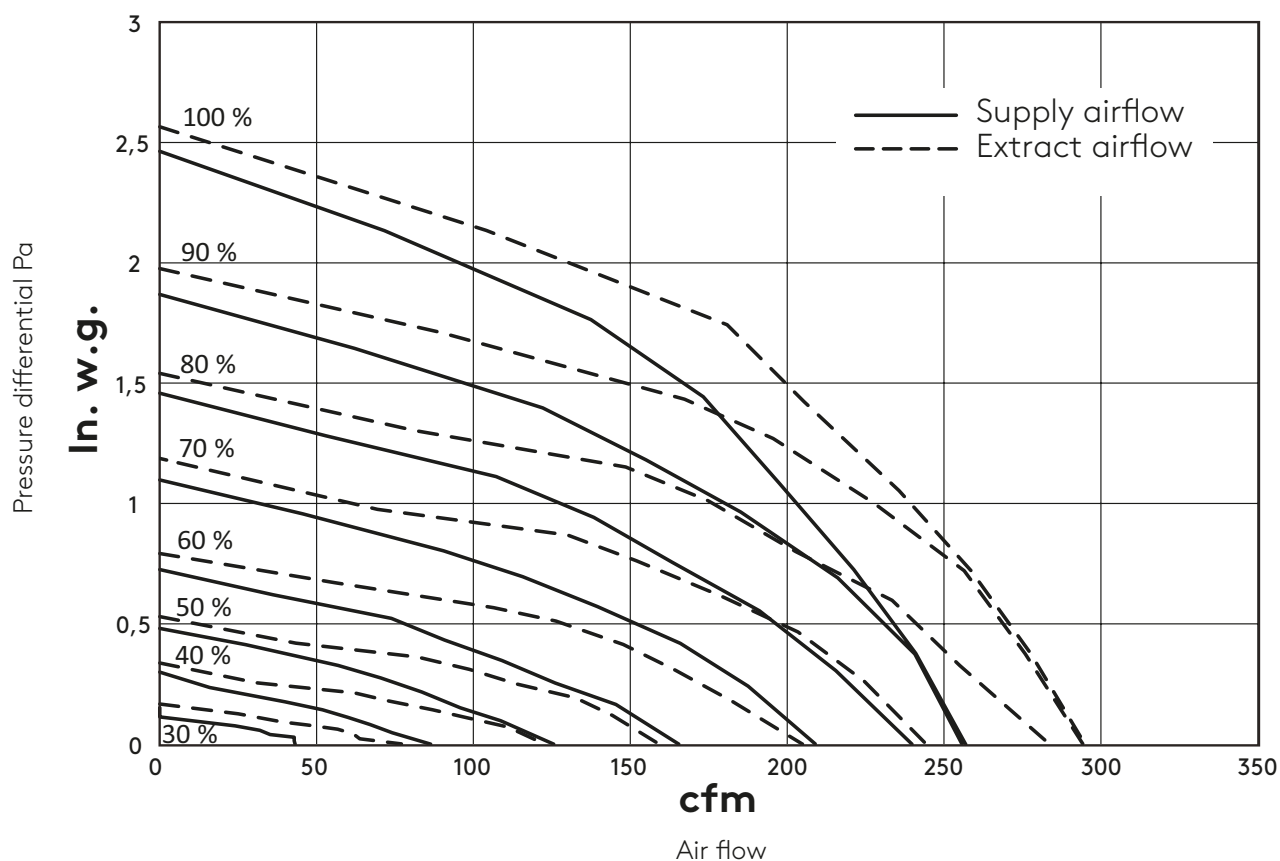

Considerable in dimensioning


The boost margin must be at least 30%



Functional diagram

Functional diagram

R5

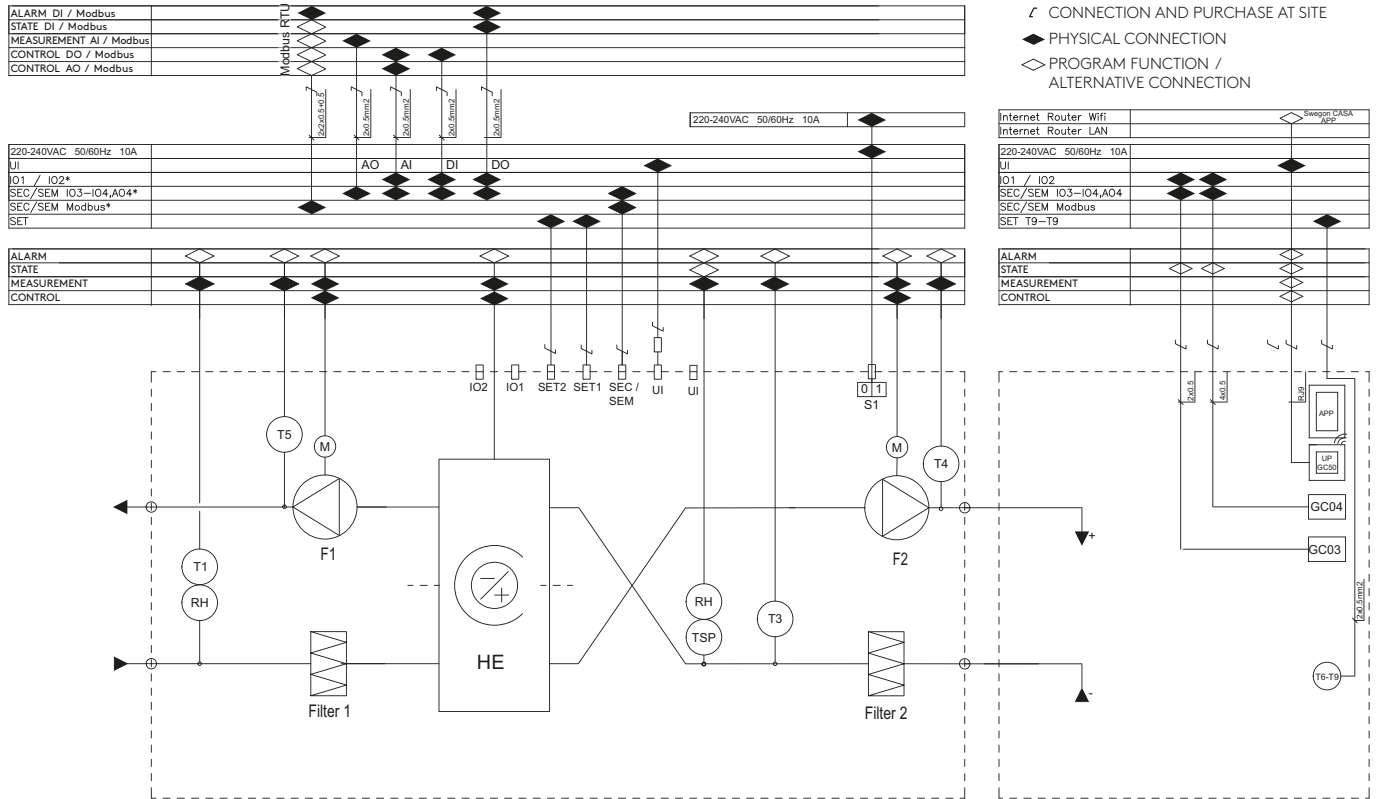

Device	Description	Modbus registers
T1	Temperature sensor, outdoor air	3x6201
T3/TSP	Temperature sensor, extract air	3x6204
T4	Temperature sensor, supply air	3x6203
T5	Temperature sensor, exhaust air	3x6205
Filter 1	Fresh air fine filter MERV13	Service reminder info 3x6129
Filter 2	Extract air fine filter MERV13	Service reminder info 3x6129
F1	Extract fan including internal overheat protection.	Control 3x6304(%), RPM 3x6306
F2	Supply fan including internal overheat protection.	Control 3x6303(%), RPM 3x6305
HE	Rotating heat exchanger (Rotor)	
HE M	A heat exchanger motor which speed is steplessly controlled based on the temperature and humidity of the supply air	Control 3x6332 (0.1xRPM)
S1	Use Switch. Note! power off the unit by removing the socket from the Mains when Service	
RH	Humidity sensor for RH automation	RH 3x6214
TSP	Extract air temperature sensor for humidity measurement	
UI	Connectors for the control panel. One connection point is wired outside the unit.	
SEC/SEM	Connector for connecting the SEC or SEM module.	
SET 1&2	Connectors for connecting the SET module.	
5V/24V	24V voltage output, which can be changed to 5V output with a jumper on the circuit board. (IO max 125 mA/3W)	
IO 1&2	Two general-purpose IO connectors. Connectors must be configured for the desired functions.	
GND	Ground for IO connections.	




Accessories	
CO2	CO2 sensor for CO2 automation
VOC	VOC sensor for VOC automation
SEM	Modbus module (Inc. 2m RJ-45 cable)
SEC	IO extension module
SET	Connection module for duct batteries and temperature sensors. (Inc. 2 x 3m RJ-45 cable)
APP	Swegon CASA mobile application for ventilation control and monitoring. Requires a Genius control panel (GC50) to operate.
UP GC50	Genius control panel that can be connected to Swegon CASA application via WiFi.
GC04	Control switch to select boost, home and away mode.
GC03	Control switch to select boost mode.

SEC	IO extension cable with Modbus RTU
SEM	IO extension module with relay and Modbus RTU (input and output connections)
SET	IO extension module for control of external accessories

Electrical wiring diagram

Electrical wiring diagram

R5

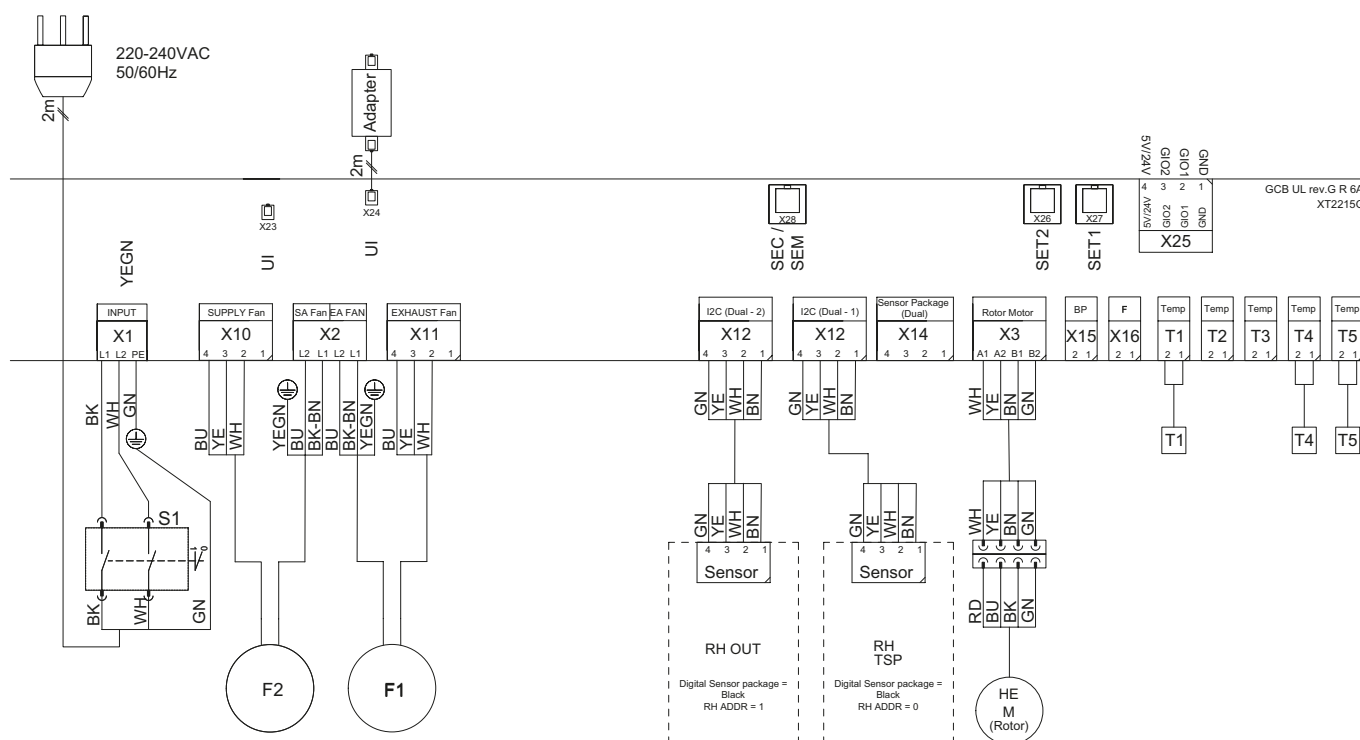

Mains:

VAC; Freq; Phase; FLA; MCA; MROPD

220-240VAC; 50/60Hz ; 1~;2.1A;2.7A;10A

Motors:

Qty; Kw(EA); HP(EA); VAC; Freq; Phase; FLA(EA)

2; 0.115 ; 0.16 ; 220-240VAC ; 50/60Hz ; 1~ ; 1.0A

Device	Description
T1	Temp. sensor, outdoor air
TSP	Temp. sensor, return air
T4	Temperature sensor, supply air
T5	Temperature sensor, exhaust air
F1	Extract fan
F2	Supply fan
M Rotor	Rotor's motor
RH	Sensor package RH
UI	Connectors for control panel

Installation options

Installation site

The temperature of the operating area of the ventilation unit must be at least $-4^{\circ}\text{F} / -20^{\circ}\text{C}$.


The temperature in the space where the unit will be installed must be more than $+50^{\circ}\text{F} (+10^{\circ}\text{C})$.

Due to the risk of disruptive noise, the ventilation unit should not be installed on the wall towards the living room or bedroom.

Wall mounting

A wall mounting bracket is supplied together with the ventilation unit.

If the wall is composed of vertical studs and wallboards, the wall must be reinforced with horizontal studs **(A)** that will support the weight of the unit. Swegon also recommends that the wall be insulated with mineral wool or similar insulation **(B)** for preventing sound from propagating to other rooms.



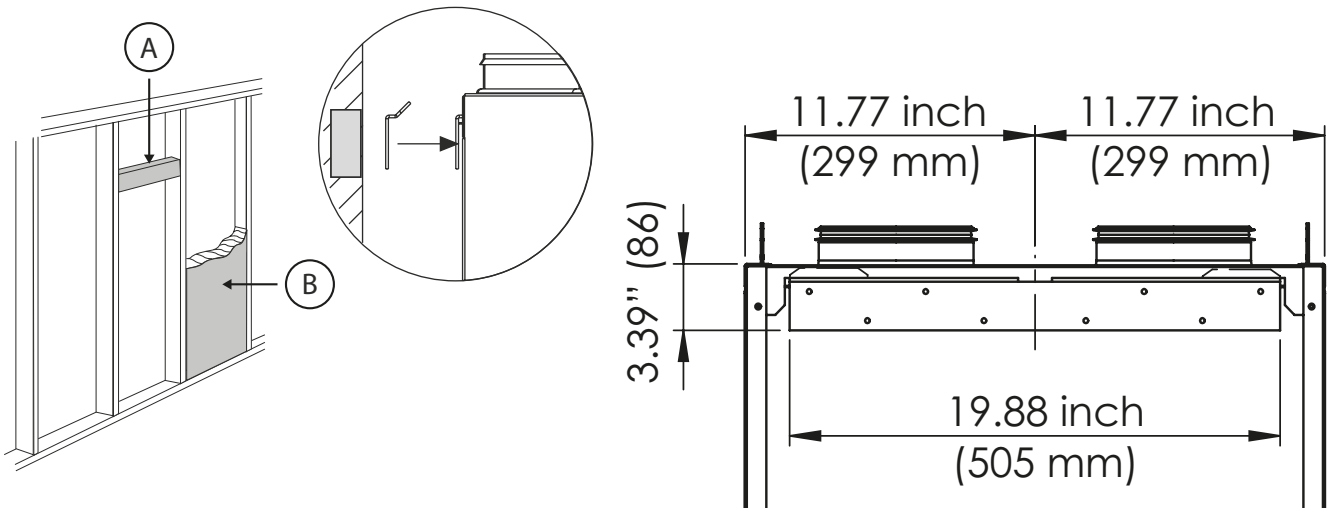


Dimensions and weight

Dimensions

R5

Weight of the unit: **165 lbs (75 kg)**

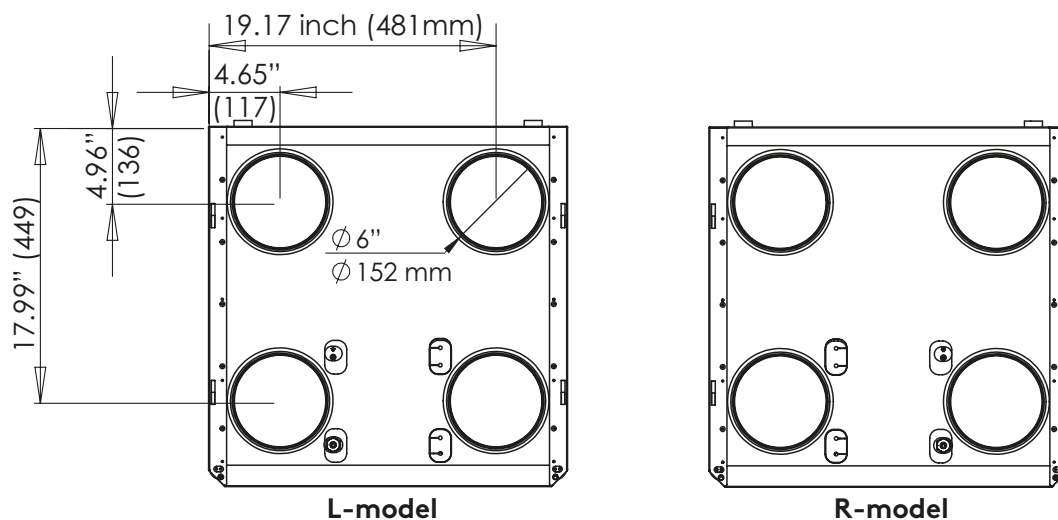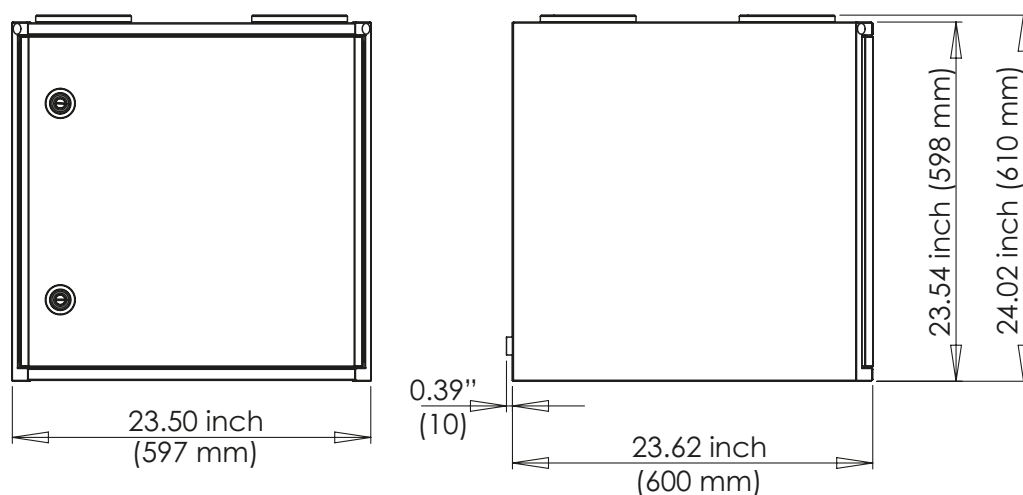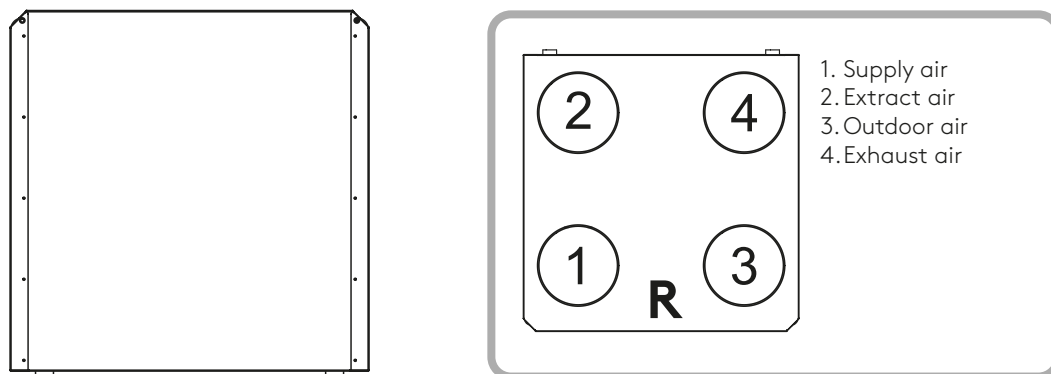

Product codes

R5

Product	Product code
CASA R5 Genius R ex.el RH NA Sorption (ERV)	R05VR00G0NHAS
CASA R5 Genius L ex.el RH NA Sorption (ERV)	R05VL00G0NHAS

Accessories

Control accessories	Part no.
GC50 Control panel NA	GC50
Mounting frame control panel	102SAK
Modular cable 33 ft (10m) white	PMK10
Modular cable 66 ft (20m) black	PMK20

Building automation	Part no.
Modbus connection module	SEM
Connection cable (configurable I/O) for Genius ventilation units	SEC
Connection module for control of the duct mounted air heater/cooler / control of shut-off dampers	SET

Mounting	Part no.
R5 Ceiling mounting frame	*****

CASA R5 GENIUS - Performance Summary

Certified by the Home Ventilating Institute (HVI) in accordance with CSA C439 under Publication 920.



General Information

Item	Value
Testing Agency	Element
Manufacturer	Swegon North America Inc.
Model	CASA R5 GENIUS
Options installed	Wall controller
Filter Type	MERV 13
Duct Size	5 in
Electrical Requirements	240 V


Certified Ventilation Ratings

Parameter	Value
Max Net Outdoor Airflow @ 0°C	97.2 L/s
Max Net Outdoor Airflow @ -25°C	68.8 L/s
LTIF	0.51
LTVR @ -25°C	0.0 %
Max Unbalanced Airflow @ -25°C	57.5 L/s
Standby Power	10.32 W
Exhaust Air Transfer Ratio	0.0070

Airflow Performance (High Speed)

External Static Pressure (Pa)	Net Supply (L/s)	Net Exhaust (L/s)	Power (W)
25	124,2	123,9	236,4
50	122,7	119,6	233,3
75	120,9	115,8	231
100	118,6	112,3	230,4
125	115,9	108,8	225,2
150	112,6	105	221,9
175	108,7	100,8	218,3
200	104,1	96	210,8
225	98,8	90,1	200,8
250	92,8	83,1	186,3
300	78,1	64,7	165
375	48,9	22,4	115,5

Fan Curve Data

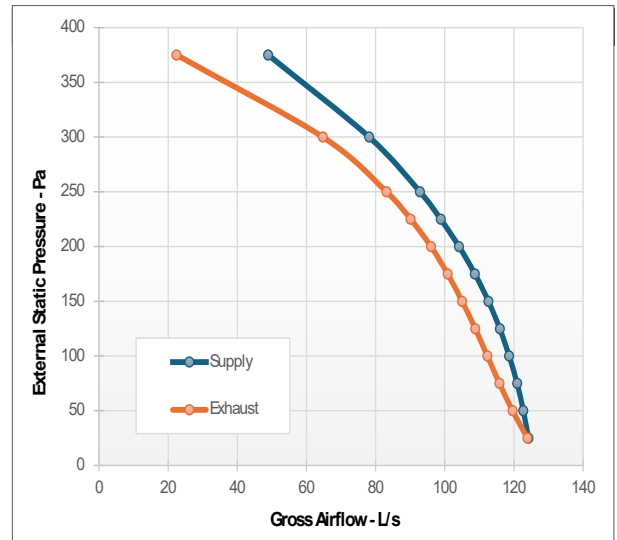

Energy Performance – Heating

Supply Temp	Net OA Airflow	Avg Power	Sensible Recovery	Adjusted Sensible Recovery	Apparent Effectiveness	Net Moisture Transfer
0°C	35.5 L/s	36.4 W	73.9 %	77.3 %	80.7 %	0.76
0°C	49.8 L/s	45.2 W	77.5 %	80.5 %	83.2 %	0.87
0°C	97.2 L/s	182.2 W	74.7 %	80.8 %	82.3 %	0.75
-25°C	68.8 L/s	72.3 W	28.4 %	29.5 %	87.4 %	0.42

Energy Performance – Cooling

Supply Temp	Net OA Airflow	Avg Power	Sensible Recovery	Adjusted Sensible Recovery	Apparent Effectiveness	Net Moisture Transfer
35°C	59.4 L/s	64.4 W	65.6 %	72.4 %	76.2 %	0.72



Feel good **inside**

